


PART	MANUFACTURER MODEL / Cat. No.
METER BOX	CAPITOL FOUNDRY MBX-5A OR APPROVED EQUAL
METER SETTER	FORD / VBHH-77-18BHC-11-77 (STD. 18" RISE) MUELLER / H-1423-2 (MUST SPECIFY 2-IN METER W/18" RISE) OR APPROVED EQUAL
METER	PROVIDED & INSTALLED BY CONTRACTOR IN ACCORDANCE WITH TOWN SPECIFICATIONS
TAPPING	SEE SHEET 2 OF 2

LID TO BE LABELED "TOWN OF CLAYTON" "WATER METER"

METER BOX

4"X8" CONCRETE SUPPORT BLOCKS


UNDISTURBED SUBGRADE

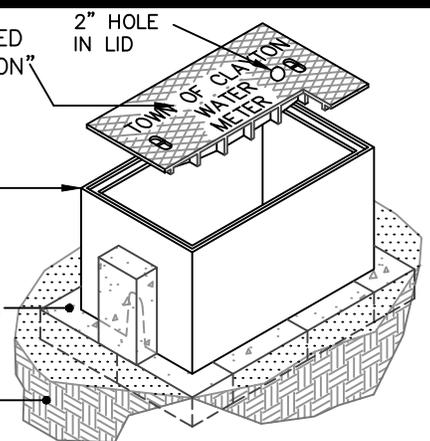

- ROAD RIGHT-OF-WAY -

TYPICAL BOX

BACK OF BOX @ RIGHT-OF-WAY LINE

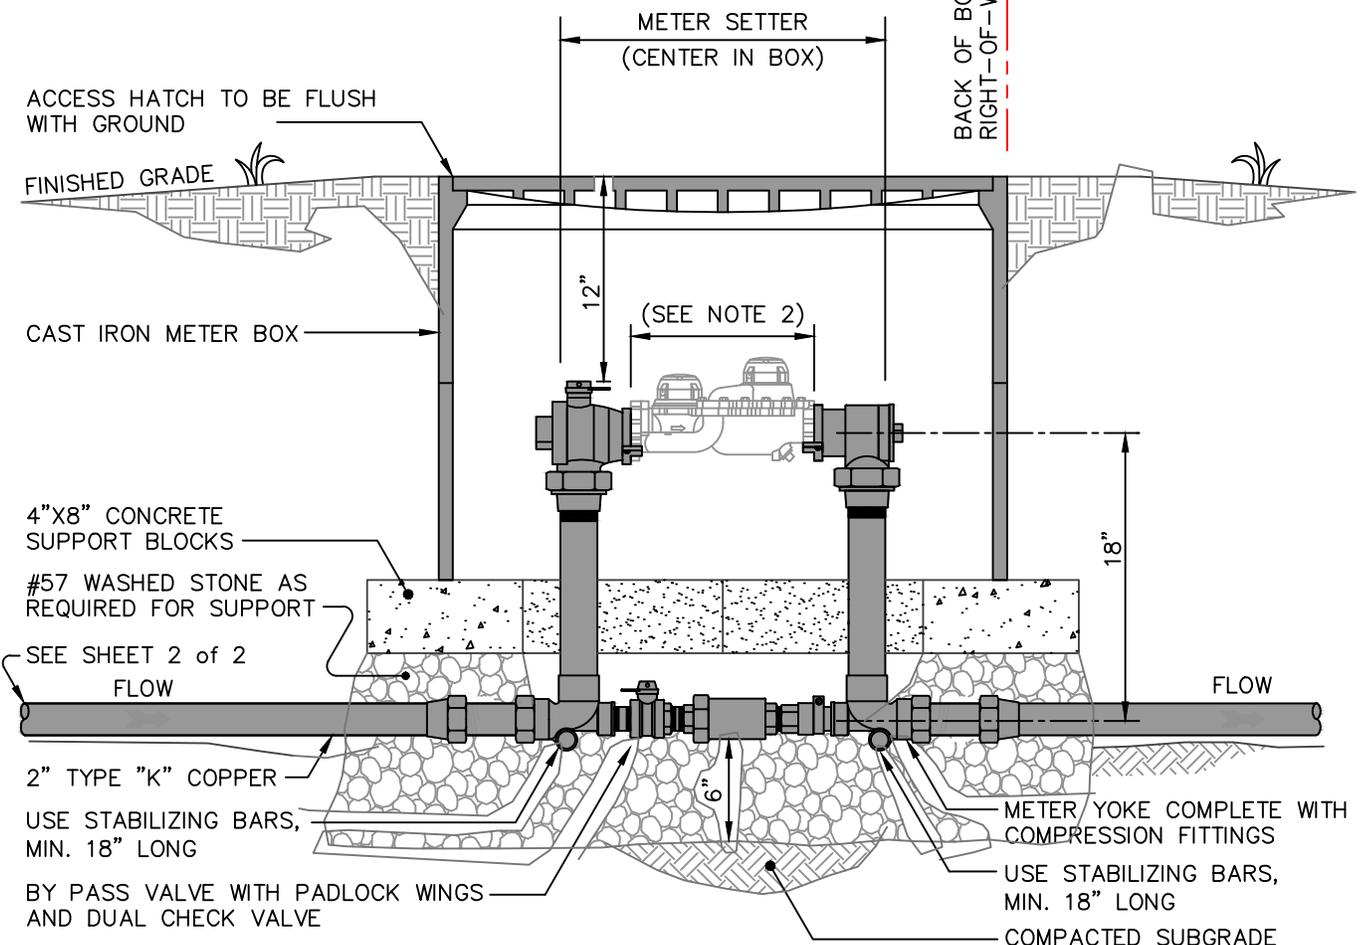

NOTES:

1. Contractor to place meter box in non-traffic area only.
2. Meter must be level across meter connections.
3. Ensure positive surface grade away from vault.



TOWN of CLAYTON

USE WITH THE TOWN of CLAYTON STANDARD SPECIFICATIONS ONLY

2" WATER METER SERVICE DETAIL

SCALE: Not To Scale	DETAIL # 2519.03
REVISION DATE: JAN. 2015	SHEET #: 1 of 2